


Flowchart B: Evaluate 1st Round Vapor Intrusion Results

DRAFT Final

v3.9 04/16/2021

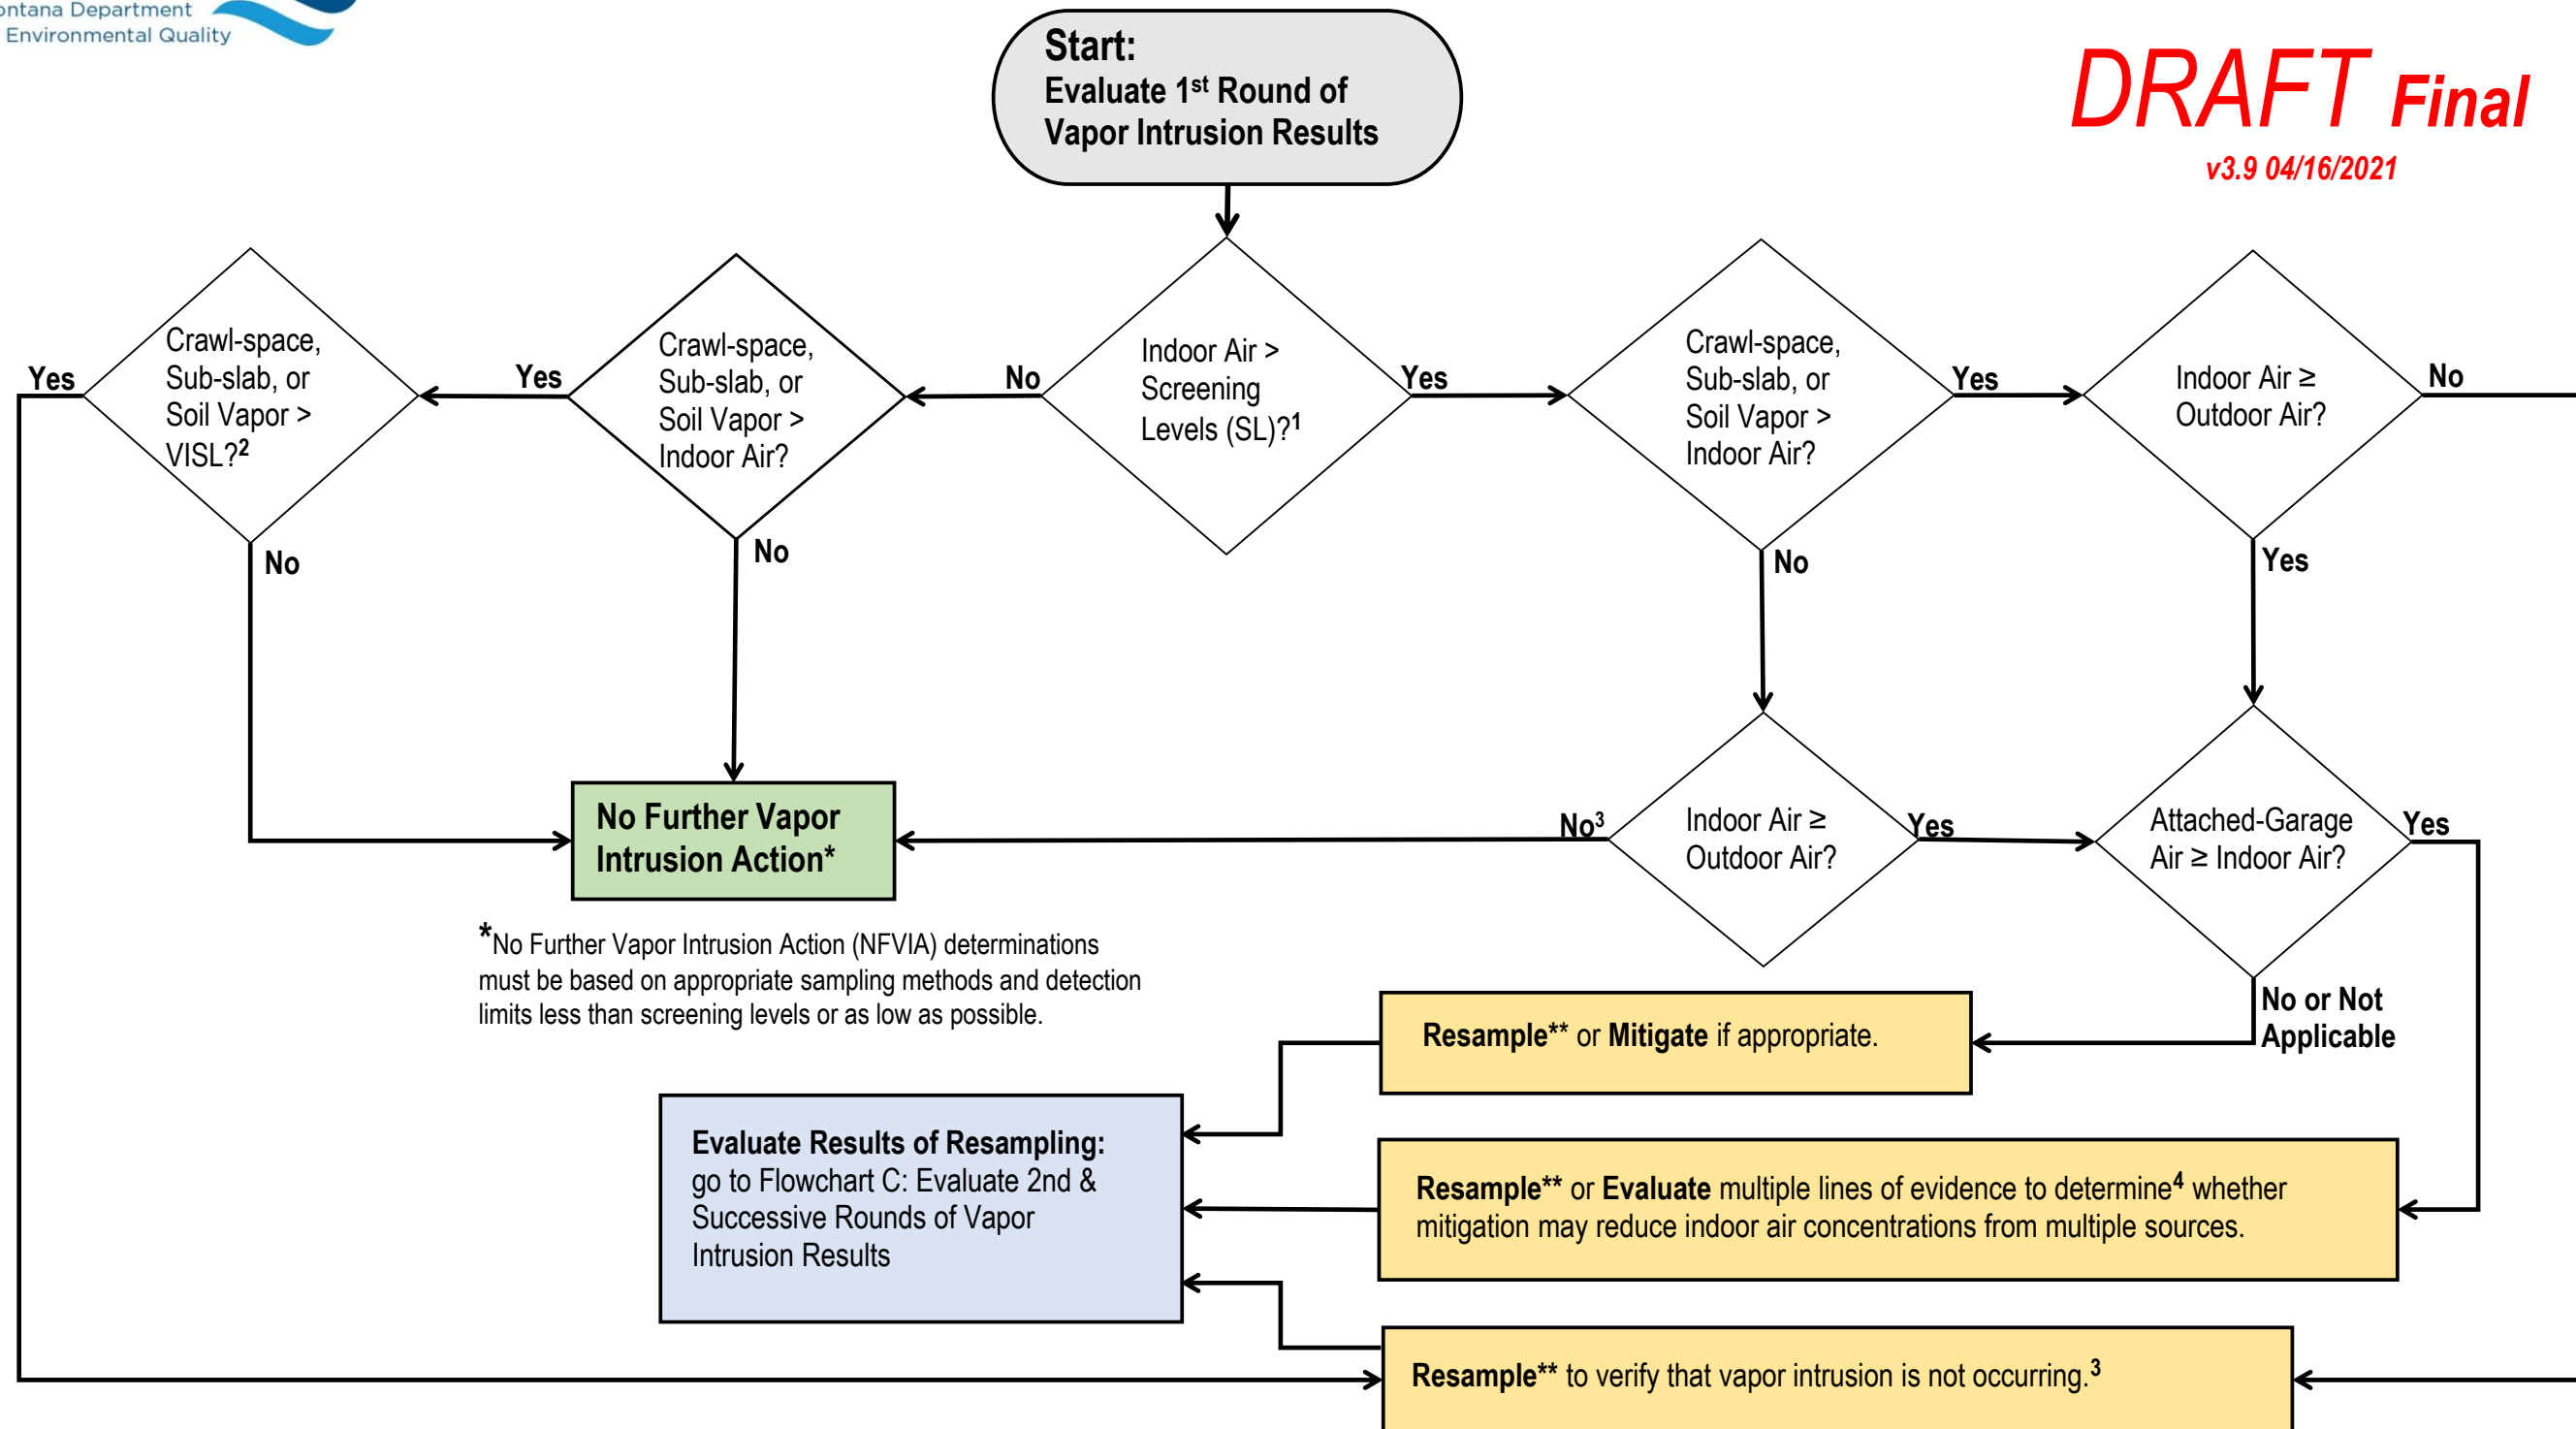

1. Refer to Flowchart A: Select Screening Levels for Indoor Air.

2. See Section-6 of the VI Guide regarding Vapor Intrusion Screening Levels (VISLs).

3. High levels of vapor contamination in outdoor air likely warrant additional investigation.

4. See Appendix B: Vapor Intrusion Decision-Making Flowchart Discussion page for information regarding multiple lines of evidence.

****** Sampling methods should be evaluated prior to resampling to assure that representative samples are being collected.